


Drawing Number
SD/1300/03

- Notes
1. All electrical equipment must be to the approval of the Director.
 2. Fuse discrimination must be applied.
 3. Size of earth conductor from column earth bolt to door to be 4mm sq. copper 56/0.30 flexible cord PVC insulated colour code green/yellow.
 4. This detail is only used where remote lamp gear is employed, usually for maintenance purposes.
 5. New lanterns for street lighting generally incorporate an integral NEMA socket for a plug-in photocell.

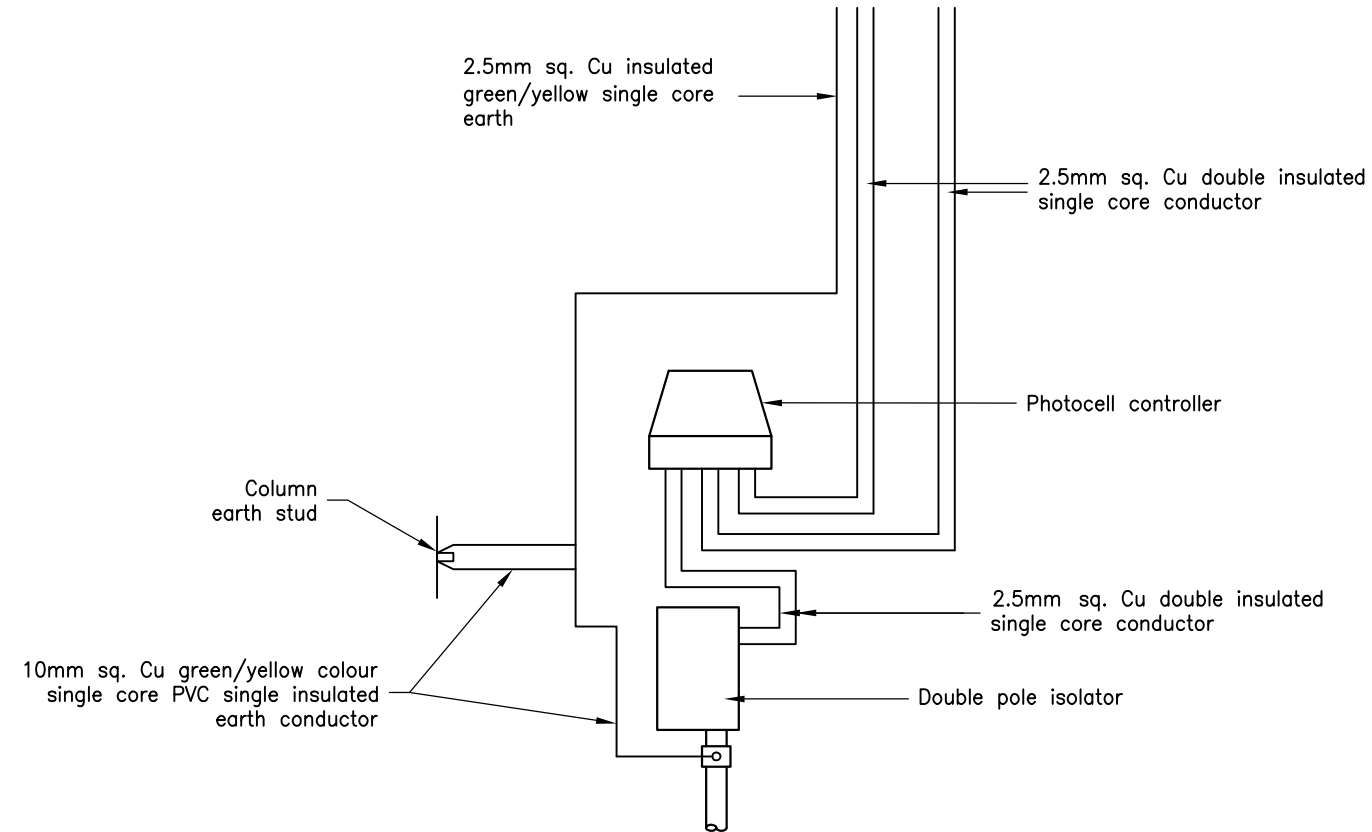

Do not scale this drawing

Rev	Date	Checked



Project
STANDARD DRAWINGS

Title
TYPICAL COLUMN/SIGN
WITH 2 PART PHOTO ELECTRIC CONTROL WIRING DETAIL

Drawing No.
SD/1300/03

Scale NOT TO SCALE Date Nov 05

Department of Environment,
Culture & Communities