


Drawing Number
SD/1100/06C

- Notes
- All dimensions are in millimetres.
 - This drawing shall be read in conjunction with SD/1100/1A, 2A, 3A.
 - Precast concrete flags shall be 400 x 400 and shall comply with BS EN 1339.
 - Where precast concrete flags are used in areas likely to be trafficked, they shall be of reinforced construction approved by the Director. The bedding detail used shall be that recommended by the manufacturer of the flags.
 - The blocks shall be laid in accordance with the recommendations in BS 7533.
 - In areas where the flags may be trafficked, or narrow strips of paving are used as a feature, the sand must be substituted by 30 mortar to designation (ii) or (iii) laid on CBGM B concrete to BS EN 14227 Pt1. (see Note 4).
 - Mortar shall be designation (ii) or (iii). Clause 2404 SHW.
 - All mortar pointing shall be colour matched to the flags.
 - Mortar pigments shall comply with BS 1014.
 - Sanded joints shall be sealed down with a stabilising compound.
 - Red tactile paving blocks extending to the back of footway shall be laid at all controlled pedestrian crossing points.
 - Crossing kerbs shall be flush with the carriageway where tactile flags are used. Maximum tolerance +6.
 - Care must be taken to ensure adequate drainage when the crossing kerb is flush with the carriageway.

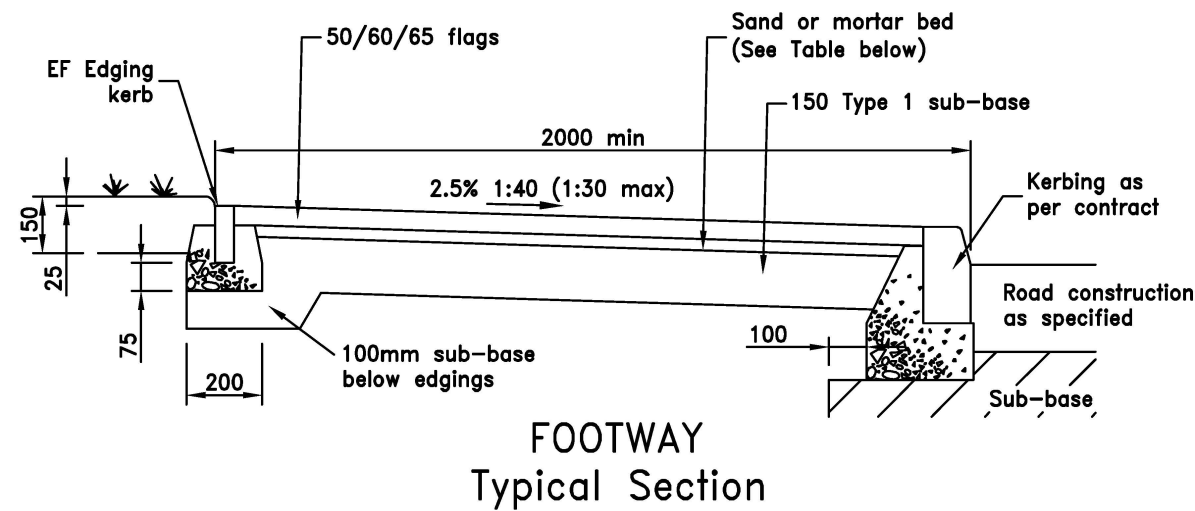

CONSTRUCTION TYPE	CONSTRUCTION THICKNESS (See Note 4)		
	Precast Concrete Flags	Mortar Bed	Type 1 Sub-base
TYPE 13	50	30	150 (2% CBR or over) 300 (<2% CBR)
TYPE 14	60	30	150 (2% CBR or over) 300 (<2% CBR)
	Artificial Stone Paving	Sand Bed	Type 1 Sub-base
TYPE 17	65	50	150 (2% CBR or over) 300 (<2% CBR)

Do not scale this drawing

C	APR 19	Updated title block	NR
B	MAY 13	Various minor amendments	KPT
A	MAR 11	Various minor amendments	KPT
Rev	Date		Checked

Project

STANDARD DRAWINGS

Drawing No.

SD/1100/06C

Title

**FOOTWAYS AND PAVED AREAS
PRECAST CONCRETE FLAGS & STONE PAVING**

Scale **NOT TO SCALE**

Date **MAY 04**

Department of Place,
Planning & Regeneration

