


Drawing Number  
SD/1300/02A

- Notes
1. All electrical equipment must be to the approval of the Director.
  2. Fuse discrimination must be applied.
  3. Size of earth conductor from column earth bolt to door to be 4mm sq. copper 56/0.30 flexible cord PVC insulated colour code green/yellow.
  4. Isolator to be phase identified.
  5. All terminations to be made using crimped lugs.
  6. To be used in residential areas only at the discretion of the Engineer.

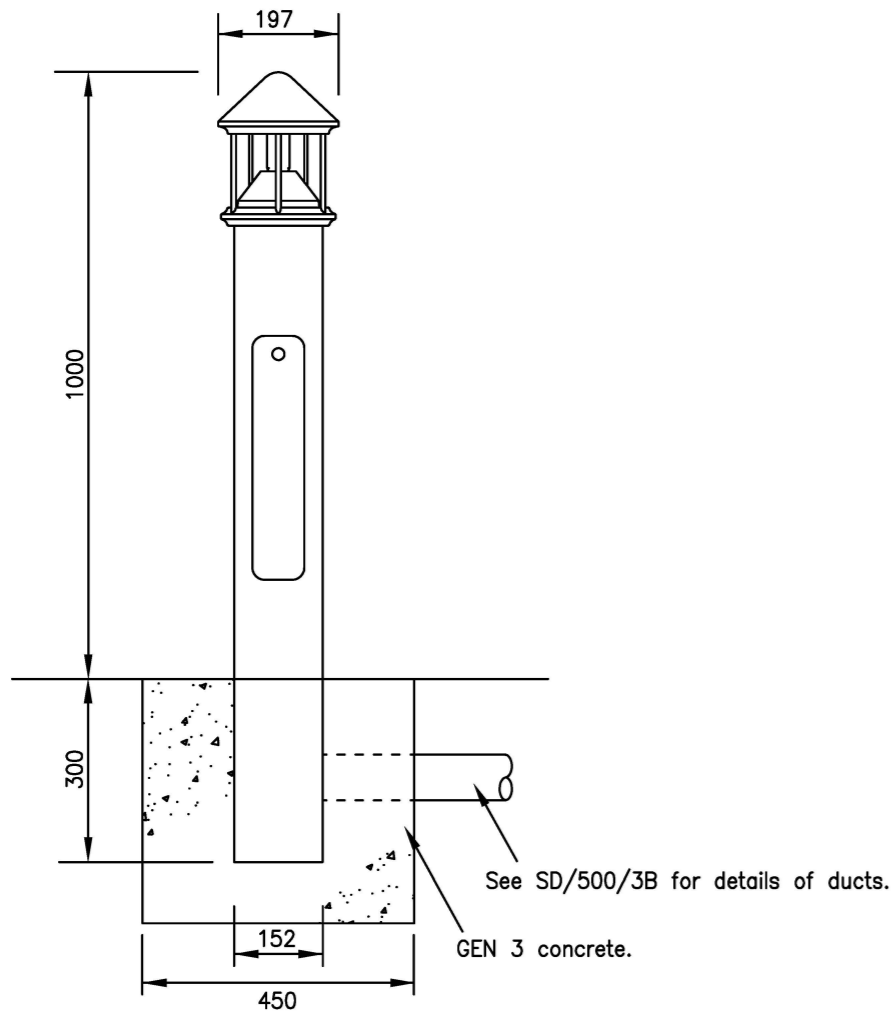

DW WINDSOR 'RIGA' BOLLARD  
With anodised louvre – no backshield  
(or similar approved product)

Lamp: 42W PL-T  
Isolation unit: Charles Manufacturing Ltd. LSI 02 or similar approved.  
Colour: PAN 7621  
Reference: RIB A 042P 81 N

Do not scale this drawing

Rev	Date	Checked
A	APR 19	NR
Updated title block		



Project  
STANDARD DRAWINGS

Title  
STREET LIGHTING BOLLARD AND VEUGTER UPLIGHTER

Drawing No.  
SD/1300/02A  
Scale NOT TO SCALE Date Jun 13

Department of Place,  
Planning & Regeneration