



Drawing Number
SD/1400/03A

- Notes
1. All electrical equipment must be to the approval of the Director.
 2. Fuse discrimination must be applied.
 3. Isolator to be phase identified.
 4. All terminations to be made using crimped lugs.
 5. Outgoing fused cables to be labelled to indicate identification numbers or other items of electrical equipment it supplies.
 6. All electrical equipment with a type D, G or H termination to be labelled with the letter F prefixing the number on the outside of the column.

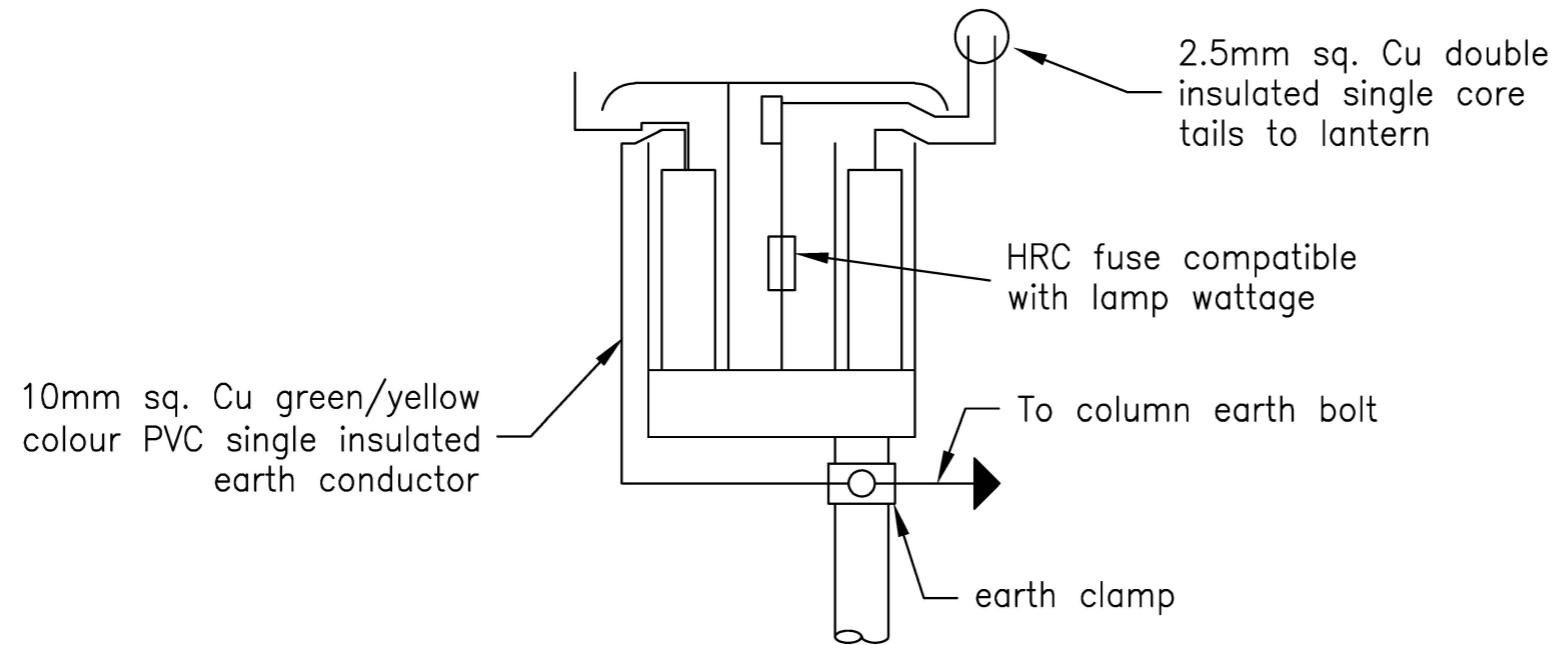

TYPE A

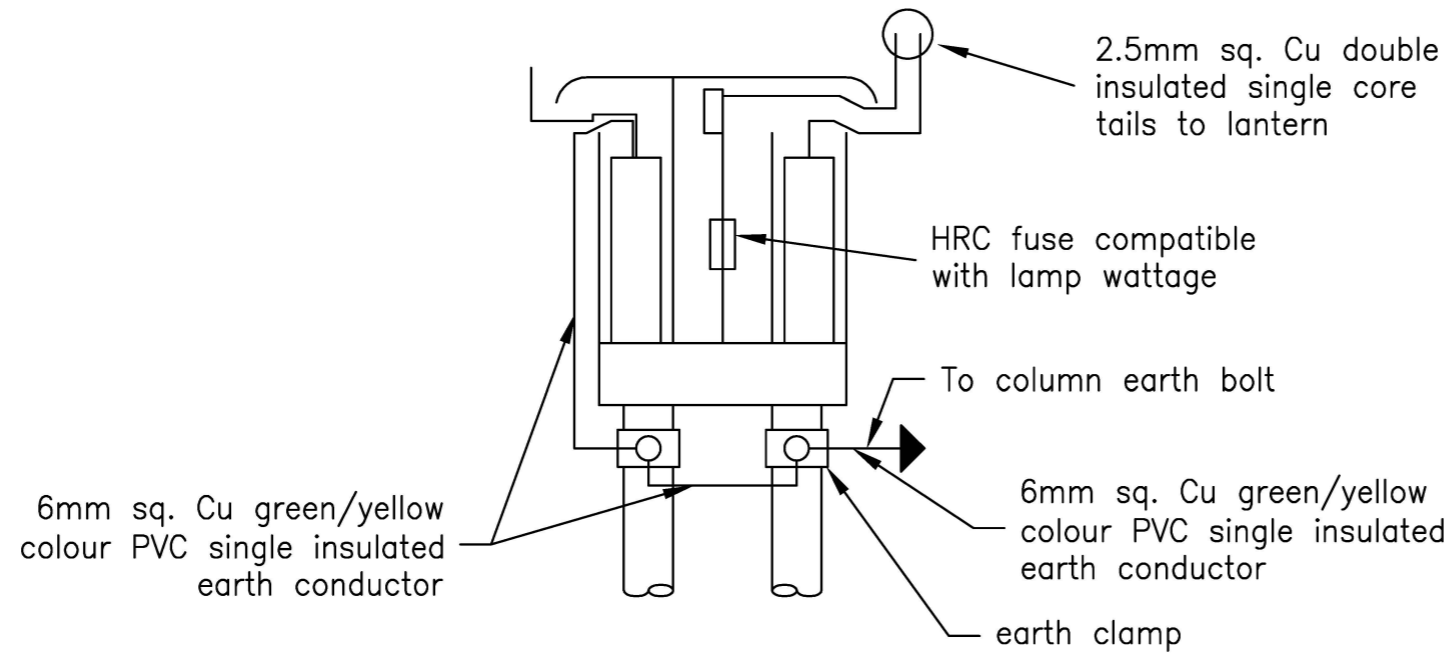

TYPE B

Do not scale this drawing

A	APR 19	Updated title block	NR
Rev	Date		Checked



Project
STANDARD DRAWINGS

Title
TERMINATION TYPES
TYPE A & B (FOR BASELIT BOLLARDS)

Drawing No.
SD/1400/03A

Scale NOT TO SCALE Date JUN 13

Department of Place,
Planning & Regeneration