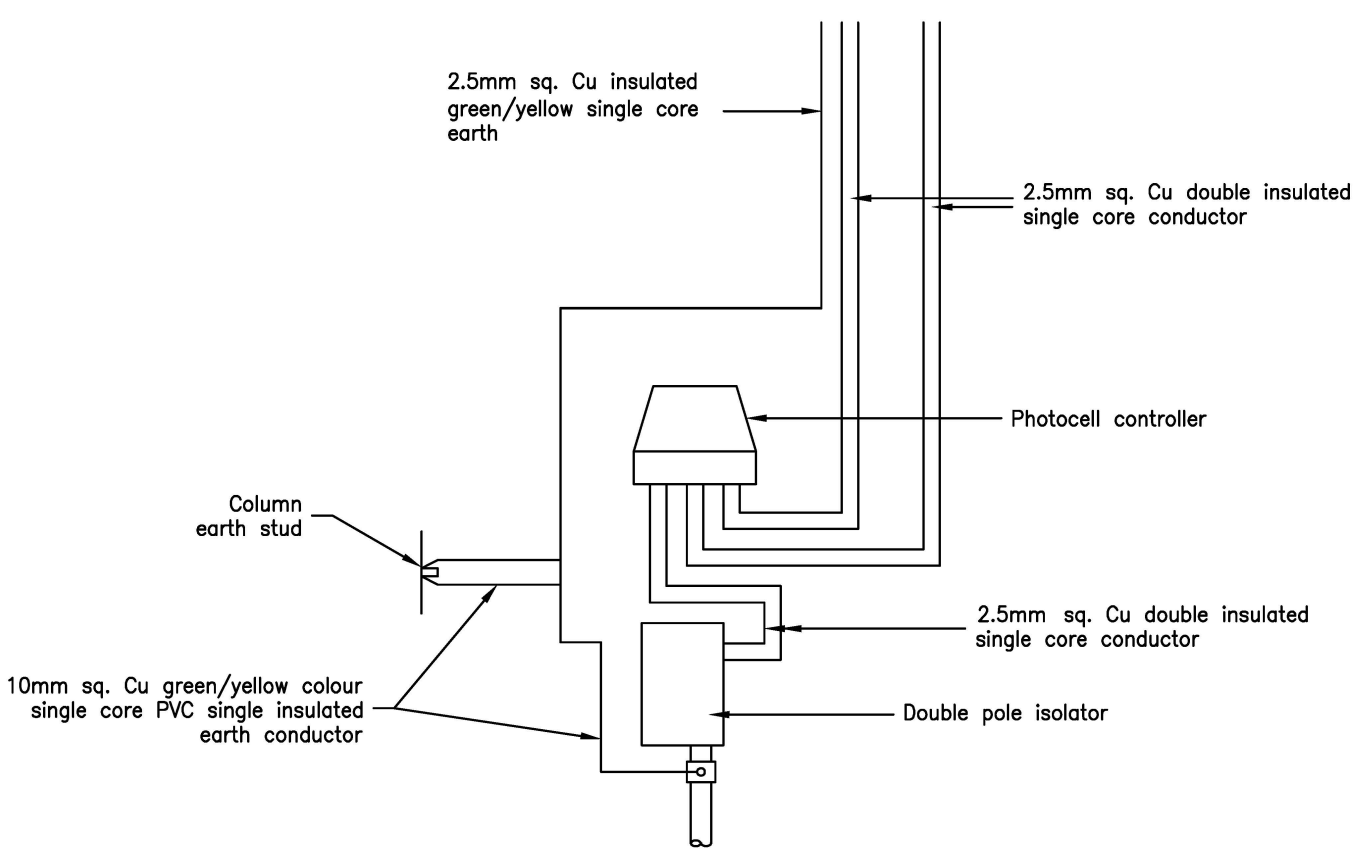



<div></div>		Drawing Number SD/1400/02A							
		Notes <div><div>1.</div><div>All electrical equipment must be to the approval of the Director.</div></div> <div><div>2.</div><div>Fuse discrimination must be applied.</div></div> <div><div>3.</div><div>Size of earth conductor from column earth bolt to door to be 4mm sq. copper 56/0.30 flexible cord PVC insulated colour code green/yellow.</div></div> <div><div>4.</div><div>This detail is only used where remote lamp gear is employed, usually for maintenance purposes.</div></div> <div><div>5.</div><div>New lanterns for street lighting generally incorporate an integral NEMA socket for a plug-in photocell.</div></div>							
		Do not scale this drawing							
		<table><tr><td>A</td><td>APR 19</td><td>Updated title block</td><td>NR</td></tr><tr><td>Rev</td><td>Date</td><td></td><td>Checked</td></tr></table>		A	APR 19	Updated title block	NR	Rev	Date
A	APR 19	Updated title block	NR						
Rev	Date		Checked						
<div></div>	Project	STANDARD DRAWINGS							
	Title	TYPICAL COLUMN/SIGN WITH 2 PART PHOTO ELECTRIC CONTROL WIRING DETAIL							
	Drawing No. SD/1400/02A								
Scale NOT TO SCALE		Date Jun 13							
		Department of Place, Planning & Regeneration							